



Testing. Advising. Assuring.

EWFA CERTIFICATE OF ASSESSMENT	CERTIFICATE No : SFC 19101700.4	Page 1 of 1
---------------------------------------	--	--------------------

Report Sponsor	Certificate Issue Date	Product Name
TBA Textiles P/L 12/8 Leighton Place Hornsby NSW 2077 , Australia	23/08/2018	The fire resistance performance of TBA Firefly Titan party wall systems if tested in accordance with AS1530.4-2014

Referenced Assessment Report	Test Method	Report Issue Date	Report Validity Date
EWFA 19107100.4	AS1530.4-2014	23/08/2018	30/11/2023

Introduction

The element of construction described below was assessed by this laboratory on behalf of the report sponsor in accordance with the stated test standard and achieved the results stated below. Refer to the referenced assessment report(s) or Regulatory Information Report(s) for a complete description of the assessed construction.

Description of Assessed Product and Performance

The scope of the assessment includes the the fire resistance performance of TBA Firefly Titan party wall systems if tested in accordance with AS1530.4-2014 , on the basis of the discussion presented in the referenced assessment , it is the opinion of this testing authority that the fire TBA Firefly Tittan party wall system would likely achieve the following fire resistance before below :

Central Barrier Material	Spacing of Vertical Fabric Support (m)	Construction Details	FRL
TBA Firefly Titan	6.3	1, 2 and 3	60/60/60

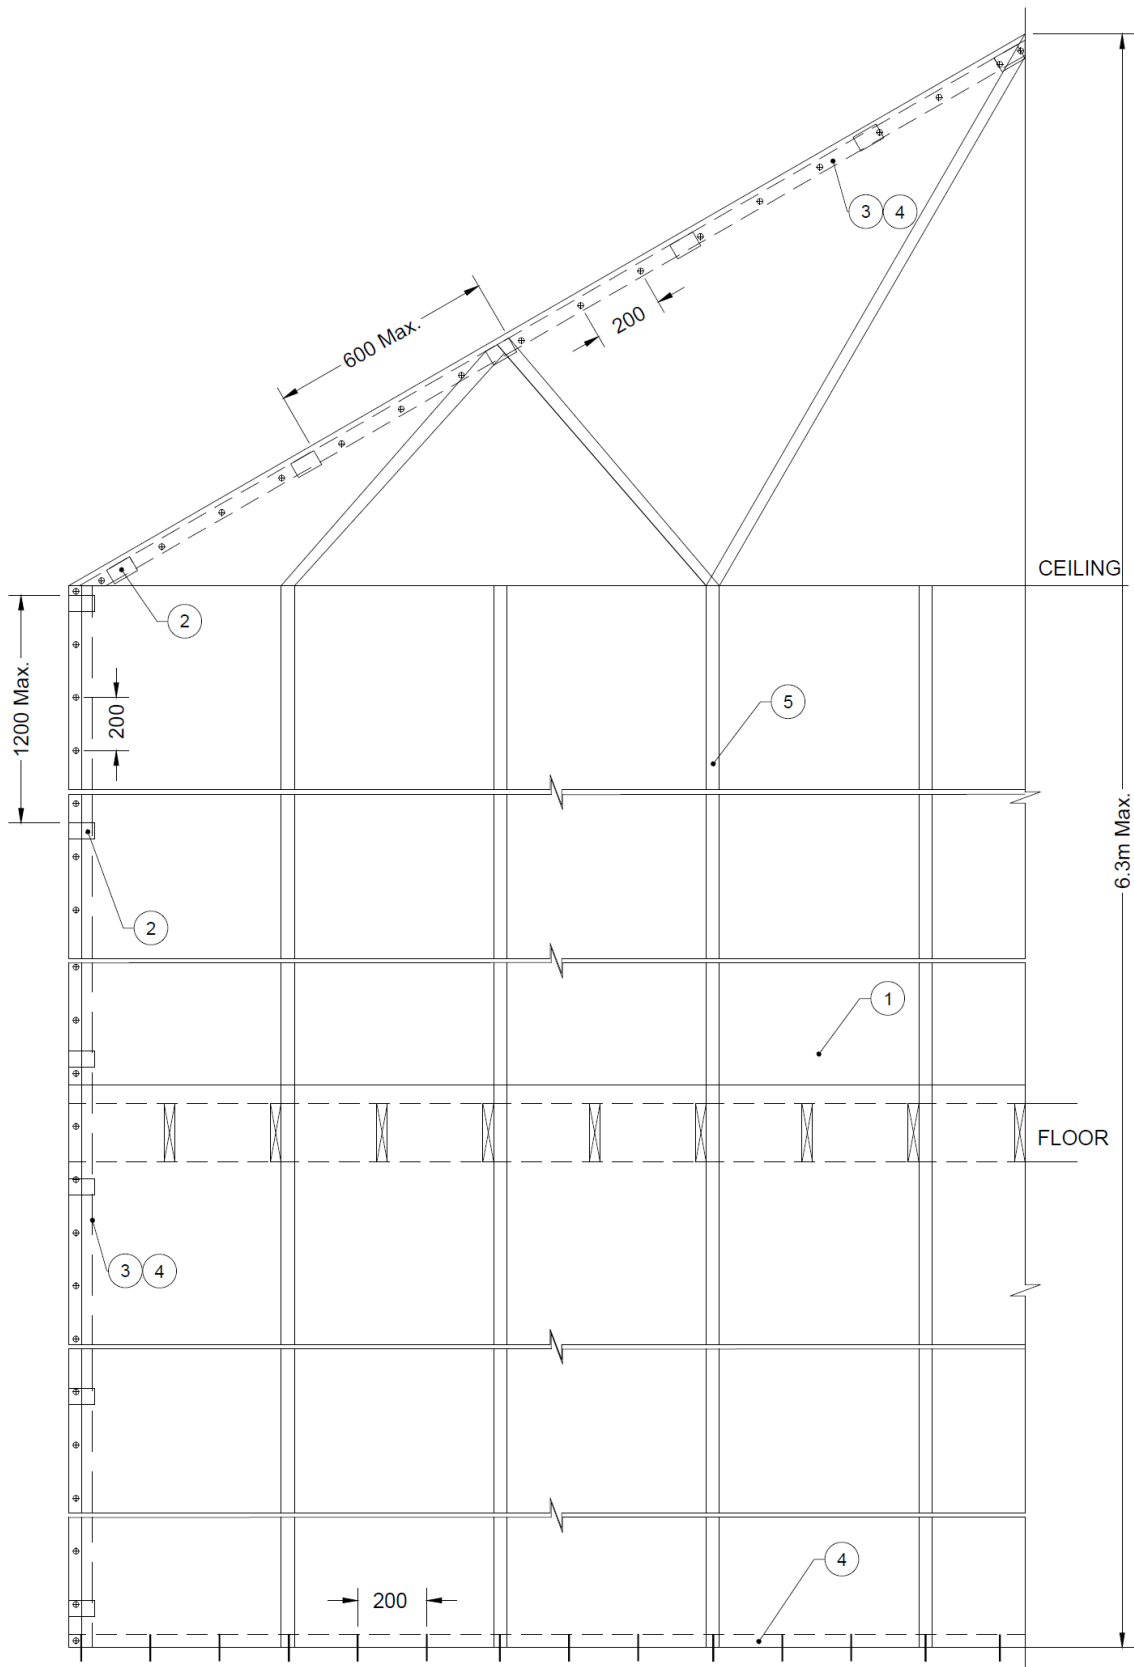


Figure 1 –Elevation of Party Wall System with TBA Firefly Titan Central Barrier

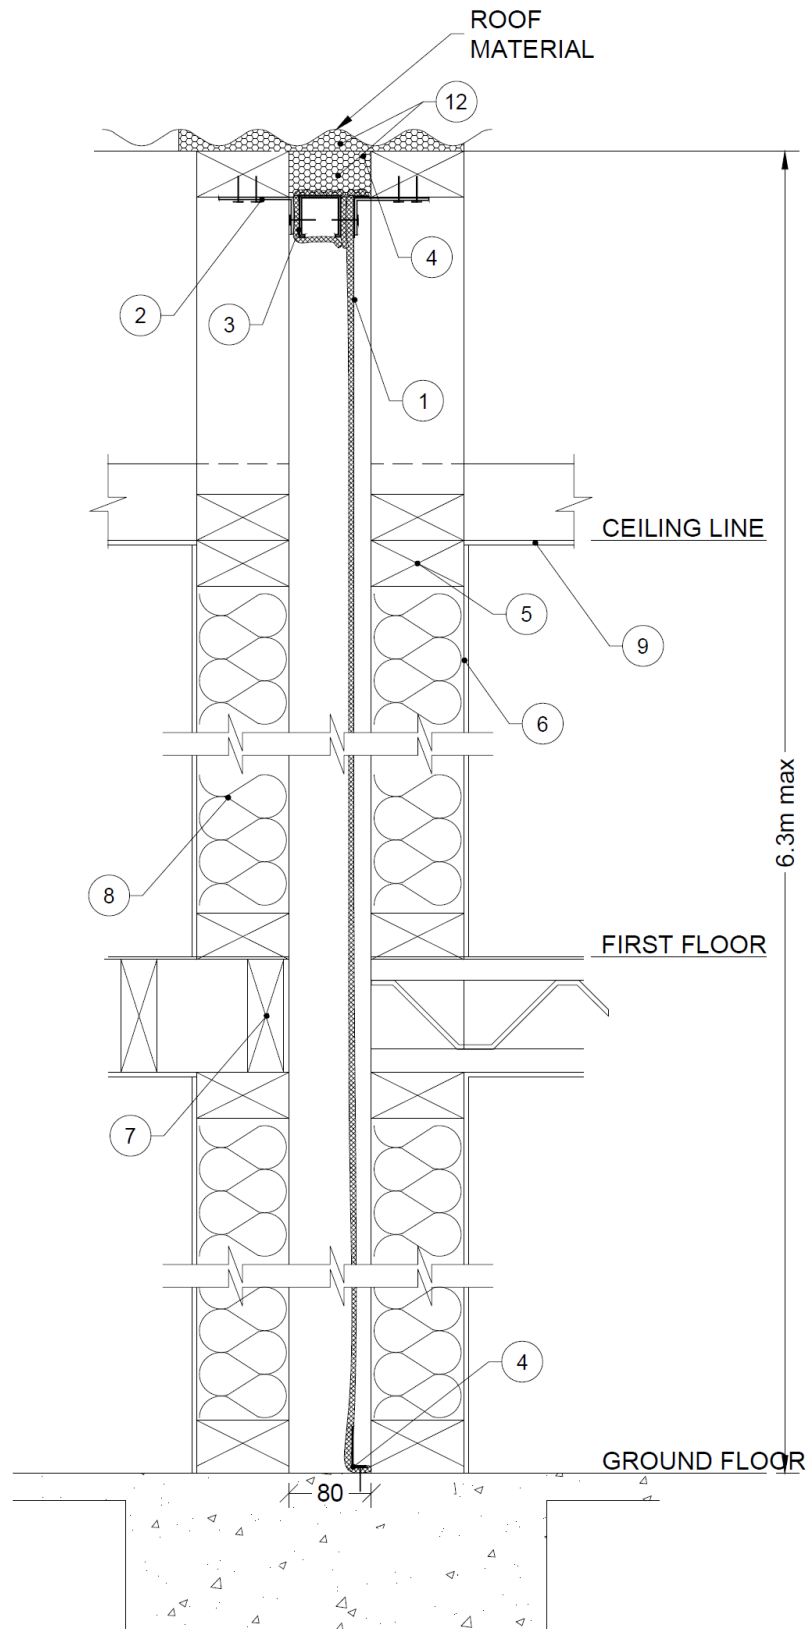


Figure 2 – Section Elevation of Party Wall with TBA Firefly Titan Central Barrier

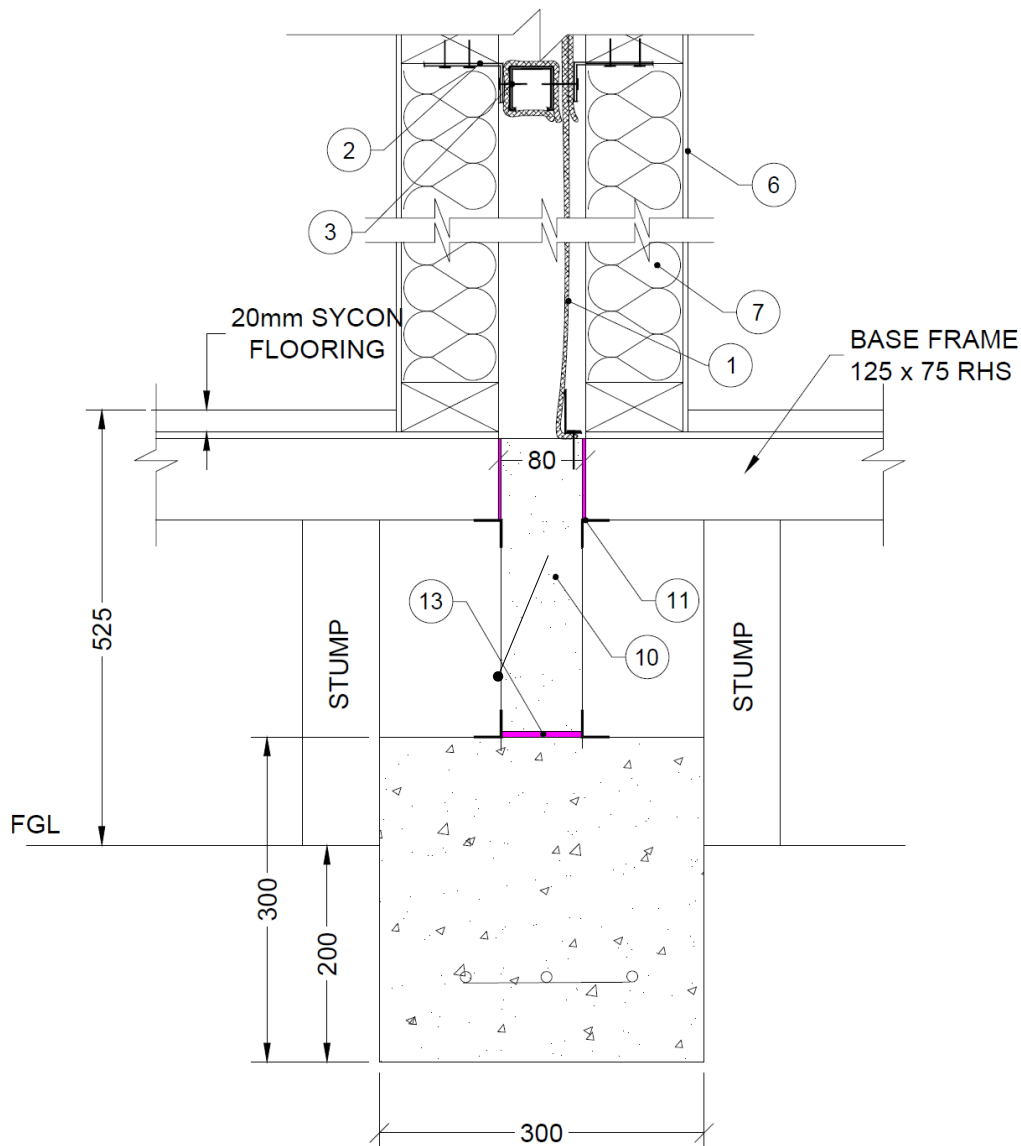


Figure 3 – Optional Wall Base Detail

Refer to the referenced assessment report(s) or Regulatory Information Report(s) for a complete description of the assessed construction.

Conditions/Validity

- THIS CERTIFICATE IS PROVIDED FOR GENERAL INFORMATION ONLY AND DOES NOT COMPLY WITH THE REGULATORY REQUIREMENTS FOR EVIDENCE OF COMPLIANCE.
- Reference should be made to the relevant test report or regulatory information report to determine the applicability of the test result to a proposed installation. Full details of the constructions and justification for the conclusions given, along with the validity statements, are given in the assessment reports.
- The results of these fire tests may be used to assess fire hazard, but it should be recognized that a single test method will not provide a full assessment of fire hazard under all conditions.

TESTING AUTHORITY	Exova Warringtonfire Aus Pty Ltd	
Address	Unit 2, 409-411 Hammond Road, Dandenong, Victoria 3175	
Phone / Fax	+61 (0)3 9767 1000 / +61 (0)3 9767 1001	
ABN	81 050 241 524	
Email / Home Page	www.exova.com	
	Prepared By:	Reviewed By:
		
	O.Saad	M.Aki