

### TBA FIREFLY NON-COMBUSTIBLE SARKING-Non BREATHABLE

#### Sarking Insulation Satisfying Non-Combustible Construction Requirements

##### PRODUCT DESCRIPTION AND TYPICAL APPLICATIONS

TBA Firefly Non-Combustible Sarking is an extra heavy duty radiant barrier consisting of a layer of woven glass fabric with aluminium foil laminate. It is designed to be used as a water barrier, vapour barrier or reflective insulation in commercial wall applications with a requirement for non-combustible materials or construction in accordance NCC 2016, BCA Volume One, C1.12. With superior tensile strength and tear resistance it provides a robust barrier to dirt, dust, draughts, wind driven rain and is suitable for use in bush fire prone areas to provide protection against burning embers. TBA Firefly Non-Combustible Sarking integral thermal insulation properties contribute to minimising heat gain and heat loss. As a non-permeable membrane it is advisable to use this product with consideration of ventilation to control condensation. TBA Firefly Non-Combustible Sarking has been tested in accordance with AS 1530.1 and may be used in non-combustible construction where there is a requirement to construct wholly of materials that are not deemed combustible.

TBA Firefly Non-Combustible Sarking meets the non-combustible insulation and material requirements of NCC 2016, Vol. 1, C1.12 and satisfies:

- C1.13(d) Fire Protected Timber: Concession.

- C2.10(ii)(B) Separation of Lift Shafts,

- Spec.C1.1,2.2 Support of another part,

- Spec.C1.1,2.5 Curtain walls and wall panels,

- Spec.C1.1,2.9(ii)(C) Residential aged care building,

##### - TYPE A FIRE-RESISTING CONSTRUCTION:

- Spec.C1.1,3.1(b) external walls and common walls,

- Spec.C1.1,3.1(d)(iii)(D) load bearing walls,

- Spec.C1.1,3.1(e) non-load bearing internal walls,

- Spec.C1.1,3.10(a)(ii, iii & v) non-combustible material,

- Spec.C1.1,3.10(c)(ii)(C) non-combustible insulation,

##### - KEY BENEFITS

- Pliable yet extremely strong and easy to use
- Provides ongoing physical protection against the elements
- Reduces temperature variations to increase energy efficiency
- Non-Combustible
- High water resistance
- Extra Heavy Duty
- Soft facings reduce flapping noise

##### TYPE B FIRE-RESISTING CONSTRUCTION:

- Spec.C1.1,4.1(b) external walls and common walls,

- Spec.C1.1,4.1(e)(iii)(D) load bearing walls,

- Spec.C1.1,4.3(a)(ii, iii & v) non-combustible material,

- Spec.C1.1,4.3(c)(ii)(C) non-combustible insulation,

- Spec.2.5,2(a) non-combustible smoke-proof walls,

- NSWC2.5(b)(iii)(B) non-combustible insulation.

##### PHYSICAL CHARACTERISTICS

Width: 1270mm

Length: 50m

Thickness: 0.2mm

m<sup>2</sup> per roll: 63.5

Weight per roll (kg): 14.5

Product Code: EKA161/1.27m

When required, TBA "Class O Fire Rated Aluminium Tape", 100mm x 45m, shall be used to seal joints between adjacent runs of TBA Firefly Non-Breathable Non-Combustible Sarking.

**TBA Protective Technologies**

**Australia Head Office**

Unit 12, 8 Leighton Place

Hornsby, NSW, 2077



**TBA Firefly Head**

**Office**

P.O. BOX 52

Laidley

QLD, 4341

Australia

**Contact Us**

Phone: (07) 5411 4209

Mobile: 0400 966 899

Email: trevor@tbafirefly.com.au



## GENERAL INSTALLATION ADVICE

As a secondary lining material TBA Firefly Non-Combustible Sarking is not designed to withstand prolonged or direct exposure to UV or the weather. External cladding materials must be applied within 4 weeks of installation TBA Firefly Non-Combustible Sarking shall be installed in accordance with AS/NZS 4200.2:1994 Pliable Building Membranes & Underlays, Part 2 Installation Requirements with the anti-glare or non-reflective surface facing outwards. Proprietary cladding systems will provide specific installation instructions to achieve their fire/acoustic/thermal/weatherproofing performance requirements. TBA Firefly Non-Combustible Sarking is designed to be compatible with these types of systems. Please contact our technical team if guidance on proprietary installation instructions is required. TBA Firefly Non-Combustible Sarking should be installed in horizontal runs across the wall starting at the bottom plate. To form a continuous membrane over the entire area of the wall successive runs shall either be taped at joints or shall overlap the lower run by 150mm. For wall applications, affix to framing members using either battens or Hammer Tacker with 40mm staples at maximum 600mm centres. At least one fastener per stud shall be provided at laps. Taping of joints, penetrations and discontinuities is recommended to provide draught sealing. An air space of minimum 20mm thickness adjacent to the reflective face is required to achieve contribution as thermal insulation.

PROPERTY	TEST	RESULT
Combustibility	AS 1530.1-1994 - Fortiglas E-glass fibre - Aluminium - Bonded laminated material	Non-Combustible Non-Combustible Meets NCC 2016 C1.12 – Non-Combustible Materials
Flammability Index	AS1530.2-1993	1 ( $\leq 5$ , Low)
Early Fire Hazard Properties	AS/NZS 1530.3-1999	0,0,0,1
Duty Classification	AS/NZS 4200.1-1994, Table 1	Extra Heavy Duty
Edge Tear Resistance	AS/NZS 4200.1 Cl.6.1.3, (TAPPI T470)	MD 493 (N/25mm), EHD LD 351 (N/25mm), EHD
Tensile Strength	AS/NZS 4200.1, (AS 1301.448s – 1991)	MD 44.4 (kN/m), MD LD 37.1 (kN/m), MD
Resistance to Dry Delamination	AS/NZS 4201.1 - 1994	Pass
Resistance to Wet Delamination	AS/NZS 4201.2 - 1994	Pass
Shrinkage	AS/NZS 4201.3 - 1994	0.0%
Water Barrier	AS/NZS 4201.4 - 1994	High
Absorbency	AS/NZS 4201.6 - 1994	46.9 g/m <sup>2</sup>
Vapour Permeance	ASTM E96	0.0193 $\mu$ /N.s
Vapour Barrier Classification	ASTM E96	Medium
pH of Extract	AS 2001.3.1 -1998	pH 6
Surface Corrosion and Wet Delamination	AS/NZS 4859.1 – 2002, App I	Pass
Infra-red Emittance	ASTM E408	0.05 (foil surface)


### SPECIFICATION NOTES

TBA Firefly Non-Breathable Non-Combustible Sarking 1270mm x 50m, tested in accordance with AS 1530.1 to satisfy the requirements of NCC 2016, BCA Volume 1, C1.12 for non-combustible construction.

- Location in building and description of work
- Installed in accordance with manufacturers' instructions.



# TENSILE STRENGTH COMPARISON OF SARKING PRODUCTS TESTED TO AS/NZS 4200.1-1994 Clause 6.1.2

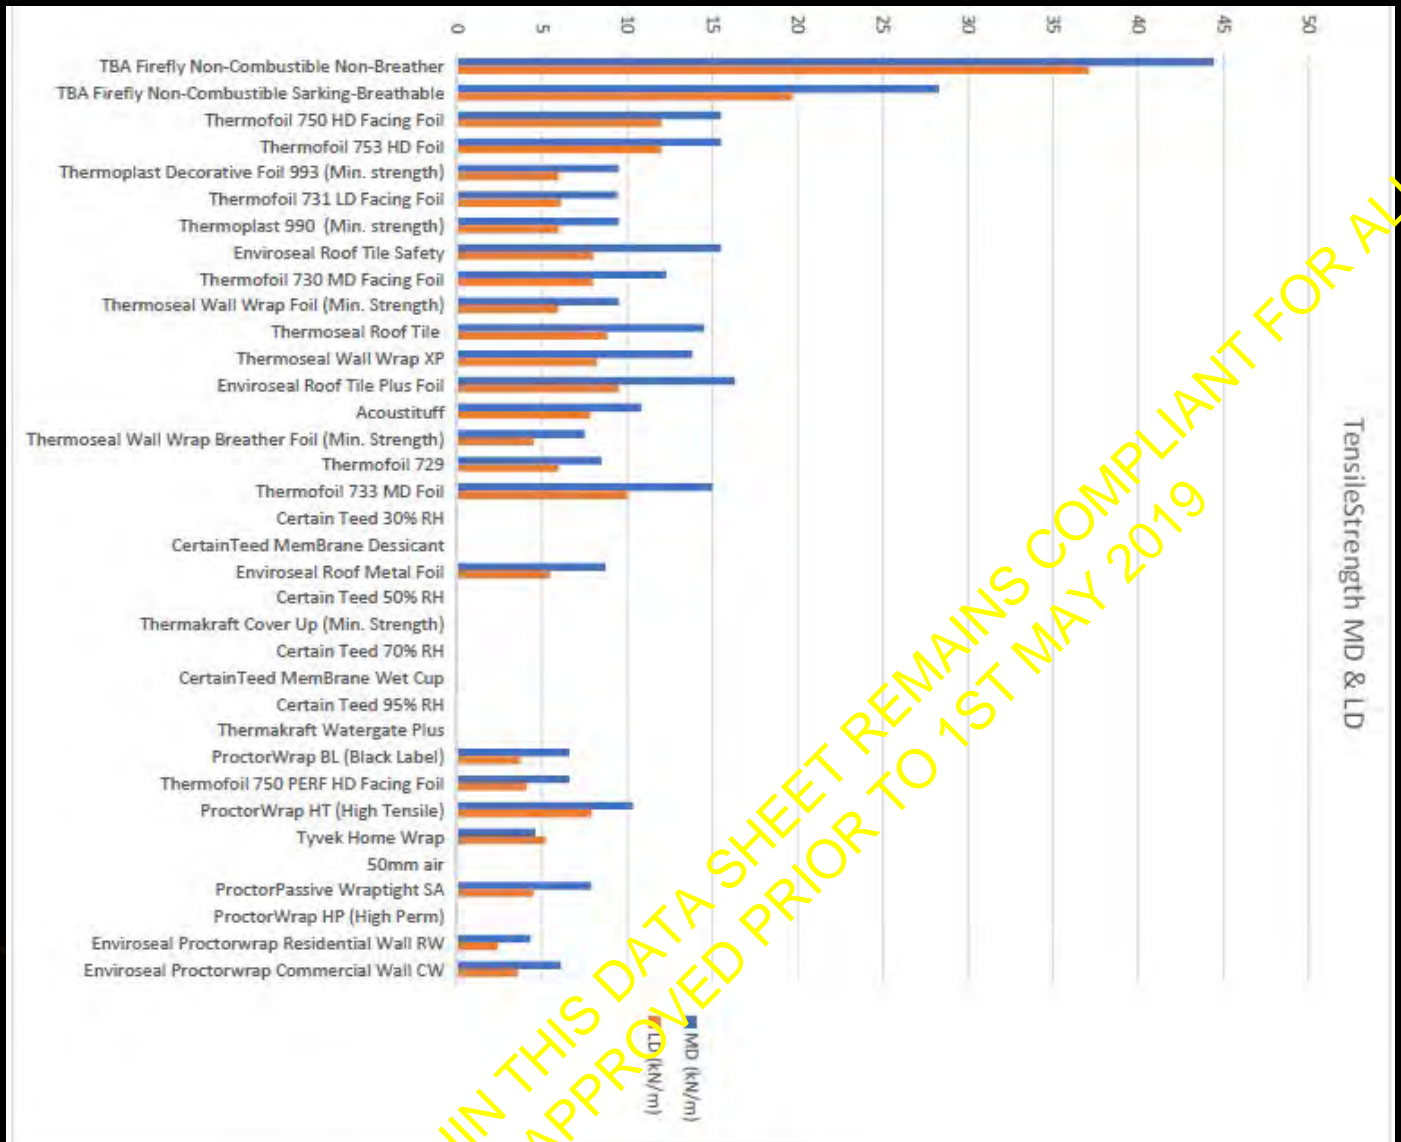

THE DATA CONTAINED WITHIN THIS DATA SHEET REMAINS COMPLIANT FOR ALL BUILDING DA'S APPROVED PRIOR TO 1ST MAY 2019



# TBA FIREFLY PRODUCE SOLUTIONS NOT EXCUSES PROTECTING



PEOPLE



BUILDING FACADES



FIRE TRUCKS FOR ALL



BATTLESHIPS



THE DATA CONTAINED WITHIN THIS DATA SHEET REMAINS COMPLIANT FOR ALL BUILDING DA'S APPROVED PRIOR TO 1ST MAY 2019

WHICH IS WHY OUR SARKING MEETS THE NON-COMBUSTIBILITY REQUIREMENTS FOR WALL SYSTEMS OF ALL TYPE A AND B CONSTRUCTION

**TBA Protective Technologies**  
Australia Head Office  
Unit 12, 8 Leighton Place  
Hornsby, NSW, 2077



**TBA Firefly Head Office**  
P.O. BOX 52  
Laidley  
QLD, 4341  
Australia

**Contact Us**  
Phone: (07) 5411 4209  
Mobile: 0400 966 899  
Email: trevor@tbafirefly.com.au

